PENTAIR
WATER SOLUTIONS

STRUCTURAL CH5811

DISTRIBUTOR ASSEMBLY INSTRUCTIONS

USED ON DST 5665, 5666, 5667, 5688, 10848, 10849, 34880, 34881, 34882, 34883, 34884

TOP MOUNT HUB AND LATERAL SYSTEM

COMPOSITE TANKS

(14", 16", 18", 21", 24", 30", 36")

DIAMETER TANKS

Step 1

Exploded view of Hub Assembly.

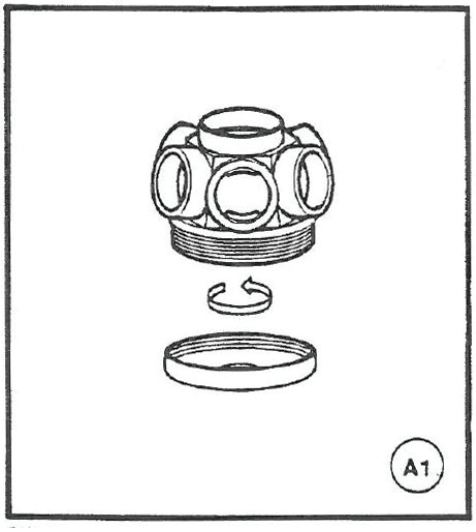

Step 2

Thread cap onto Hub and insert through tank opening. (Holding Hub as shown).

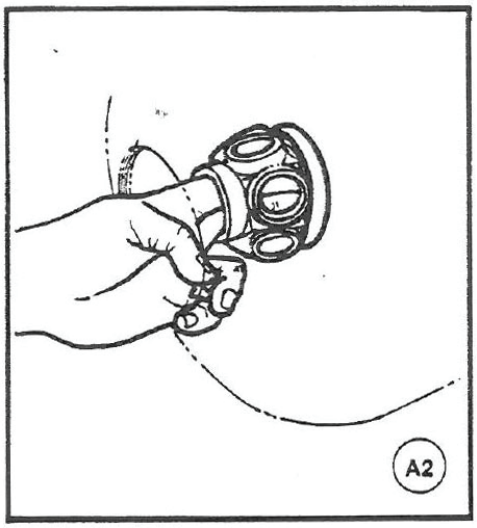

Step 3

After assembly is inside the tank, rotate the assembly 90°. Hold Hub Assembly with one hand, as shown, and assemble laterals by inserting and twisting clockwise.

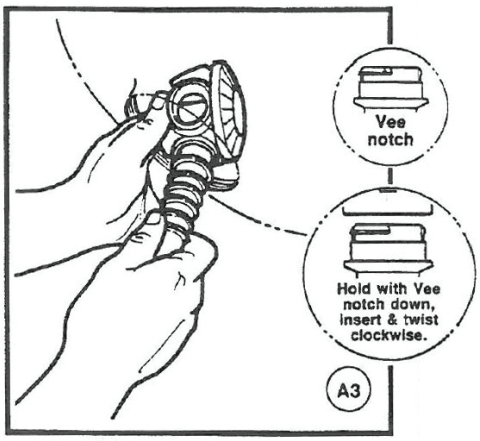

Step 4

After all laterals are assembled, hold the assembly, as shown, and using universal primer and cement, bond the 1-1/2" riser tube into Hub and lateral assembly. Riser tube can now be cut to proper length to accommodate top mounted valve.

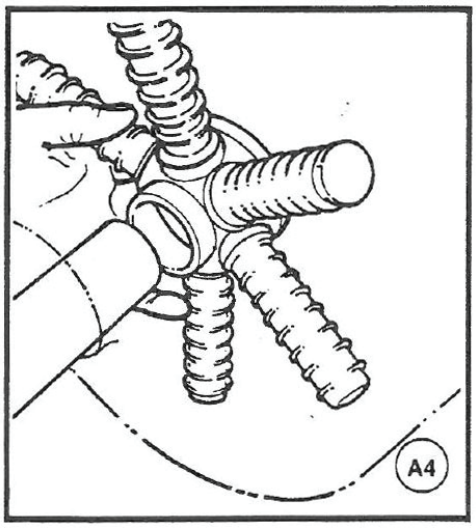

CALIFORNIA PROPOSITION 65 WARNING

⚠**WARNING:** This product contains chemicals known to the State of California to cause cancer or birth defects or other reproductive harm.

For Pentair Product Warranties visit the website or contact Pentair at the phone numbers below:

Para obtener garantías de productos Pentair, visite el sitio web o comuníquese con Pentair a los números de teléfono a continuación:

Pour connaître les garanties des produits Pentair, visitez le site Web ou contactez Pentair aux numéros de téléphone ci-dessous :

Pentair.com/assets/residential-filtration-warranty

PENTAIR
WATER SOLUTIONS

Pentair Residential Filtration, LLC
13845 Bishops Dr. | Suite 200 | Brookfield, WI 53005 | United States
P: 262.238.4400 | Customer Service: 800.279.9404 | tech-support@pentair.com | pentair.com

All indicated Pentair trademarks and logos are property of Pentair. Third party registered and unregistered trademarks and logos are the property of their respective owners.

©2025 Pentair. All Rights Reserved.

CH5811 Rev C MY25